


NOTES:

1. DIESEL USE
2. ENVIROLASTIC 940 DTM POLYASPARTIC URETHANE COATING FOR HIGH PERFORMANCE FINISH (MEMCO GREY)
3. UL 2085 LABELED AND LISTED
4. 2 HOUR RATING TESTED TO SWRI 97-04 NFPA 30 A FIRE RESISTANT TANK
5. ENGINEERED HURRICANE TIE-DOWN
6. LEAD TIME IS DEPENDENT ON IMMEDIATE APPROVAL

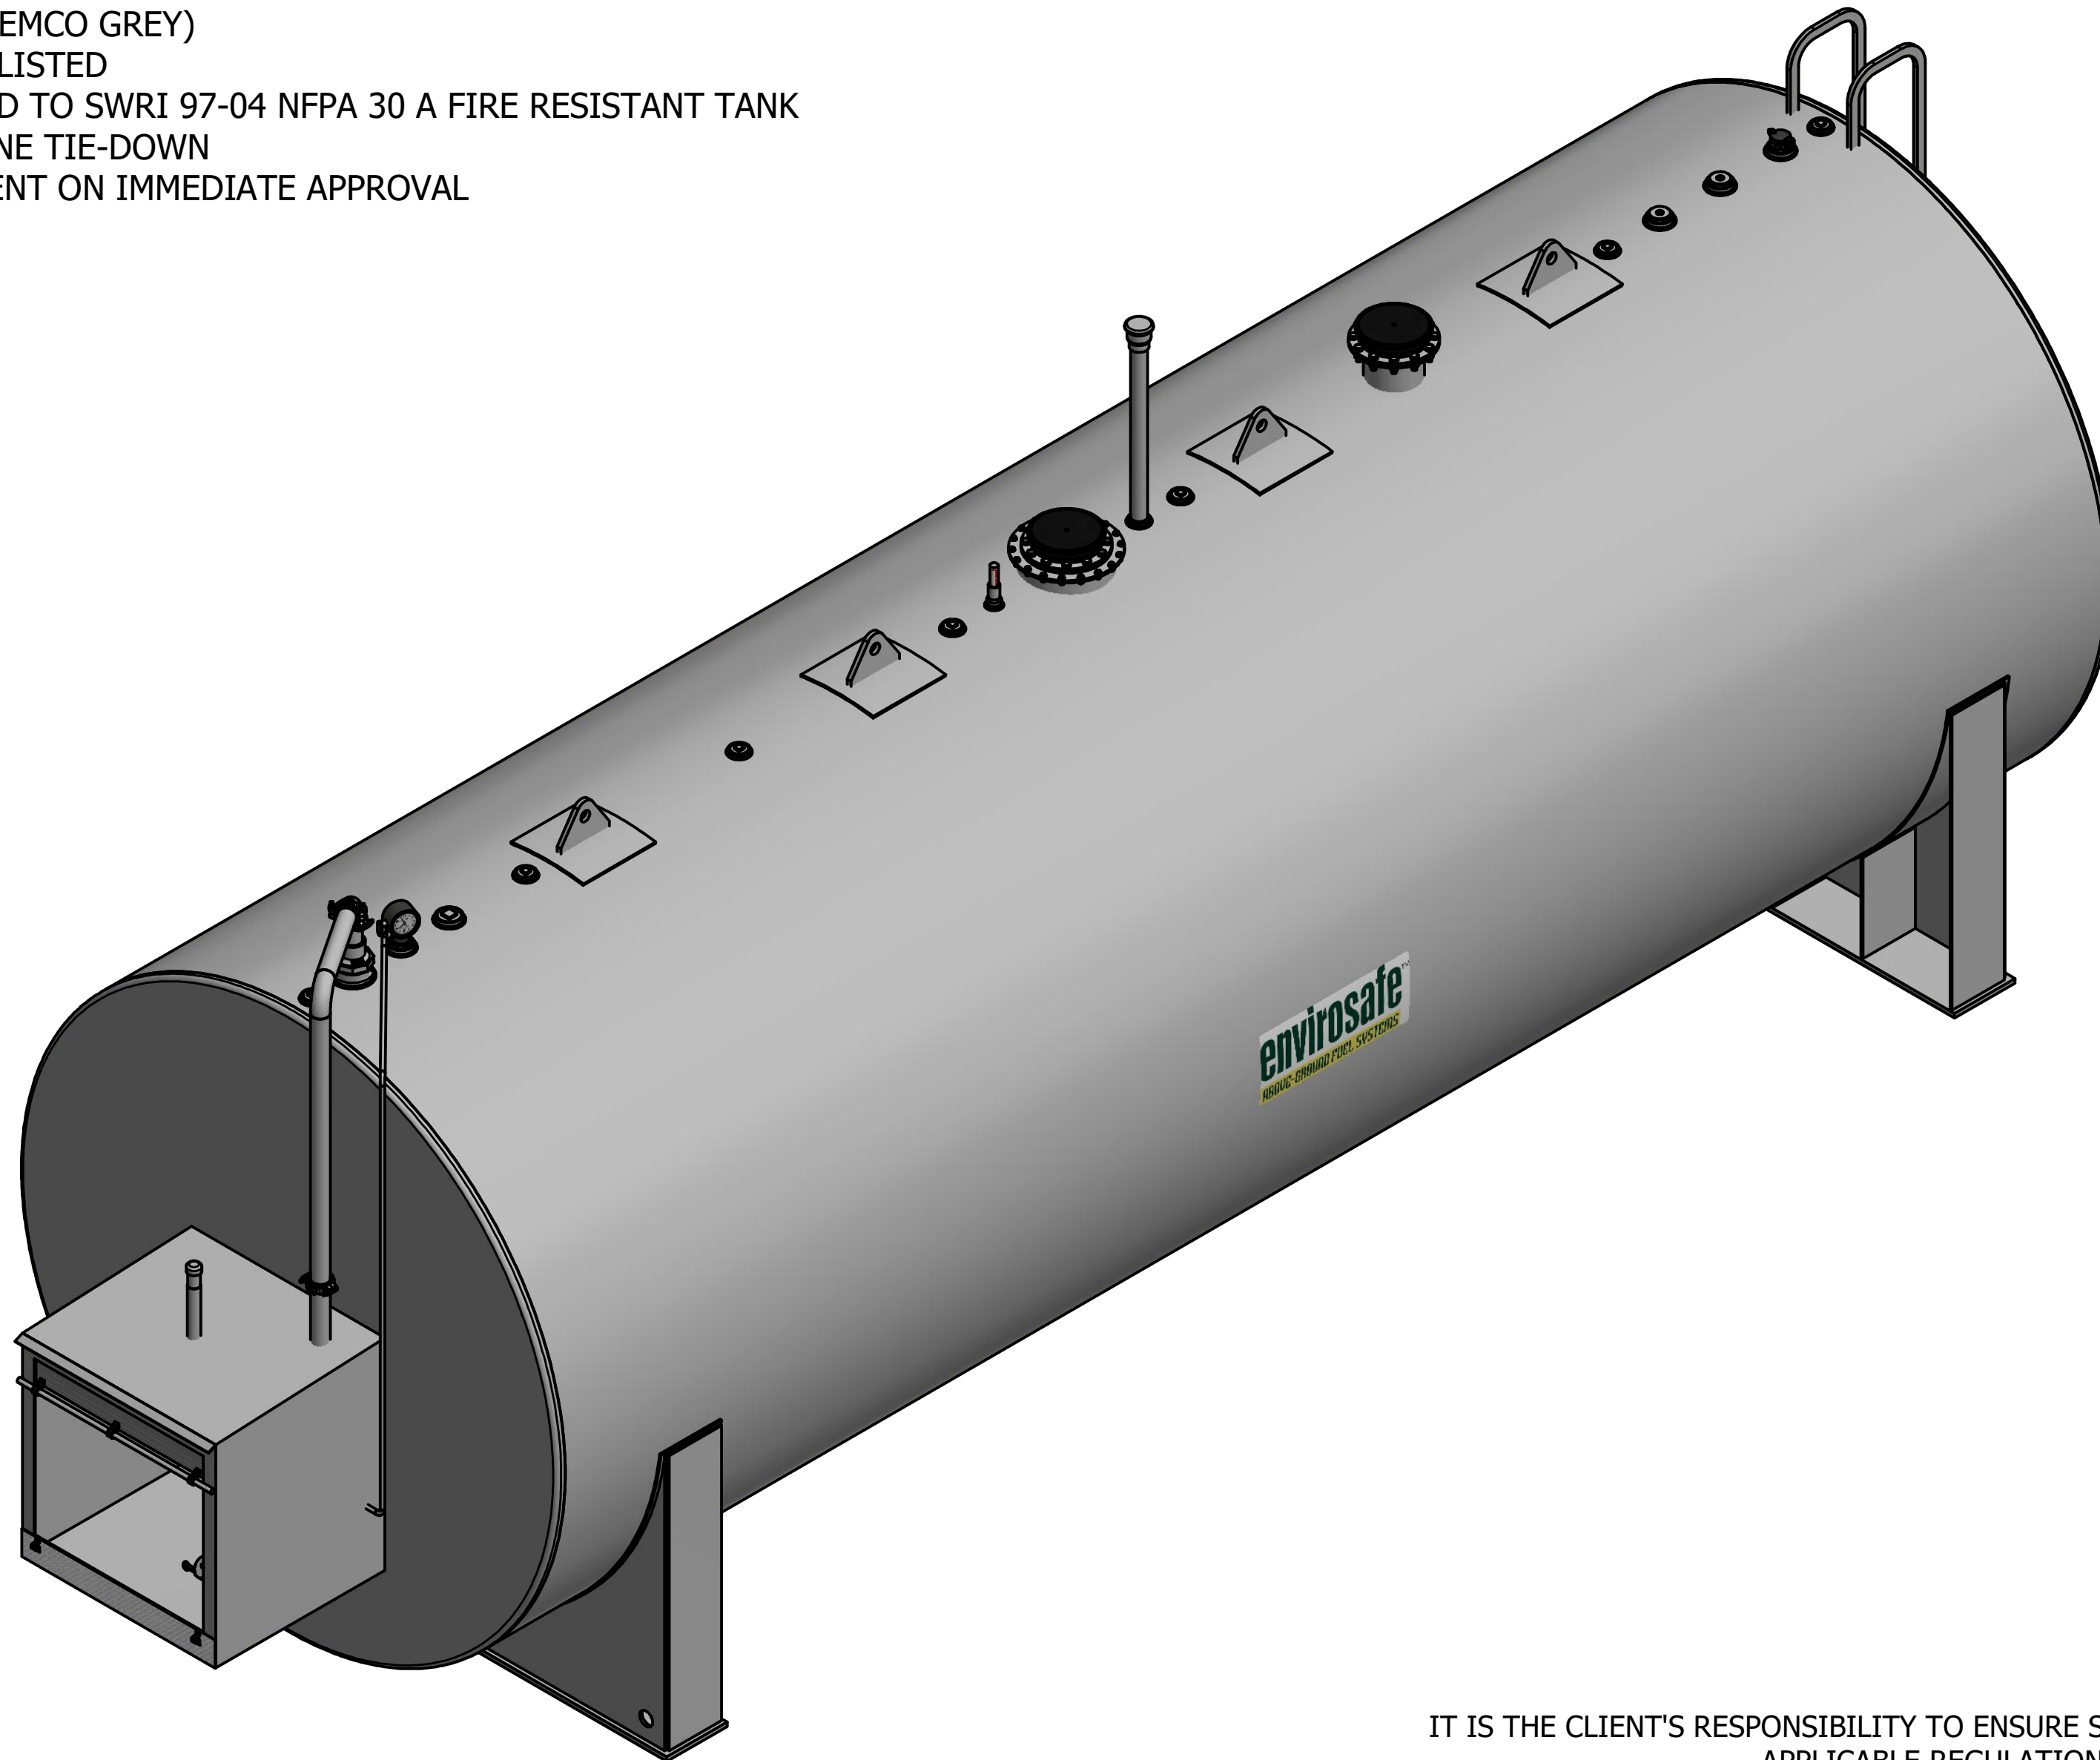


IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN



#

STI
SwRI
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY AP	4/24/2020	MEMCO, INC	
MEMCO REP		 20,000 GALLON FIREGUARD GENERATOR SYSTEM <small>ABOVE-GROUND FUEL SYSTEMS</small>	
QUOTE #			
Customer Approval Signature		SIZE C	DWG NO
CUSTOMER REQUESTED COMPLETION DATE :		SCALE	REV
		SHEET 1 OF 5	

PARTS LIST			PARTS LIST		
ITEM	QTY	DESCRIPTION	ITEM	QTY	DESCRIPTION
1	1	20,000 GALLON FIREGUARD TANK MOUNTED ON SADDLES	12	1	3" OVERFILL PREVENTION VALVE WITH TEST MECHANISM AND DIFFUSER
2	1	18" MANWAY W/10" NECK FOR EASY INNER TANK ACCESSIBILITY	13	1	3" GROUND LEVEL FILL WITH DUST CAP AND ADAPTOR
3	1	6 IN NPT THREADED FLANGE	14	1	918 CLOCK GAUGE WITH ALARM BOX & STANDARD FLOAT
4	5	4 IN NPT THREADED FLANGE	15	1	MONITORING CAP 2"
5	7	3" NPT THREADED FLANGE (CONCRETE PORT)	16	1	INTERSTITIAL LEAK GAUGE
6	1	3 IN NPT THREADED FLANGE	17	1	MEMCO 1" RETURN LINE FITTINGS ONLY
7	2	2 IN NPT THREADED FLANGE	18	1	STEP LADDER WITH SAFETY SHIELD
8	2	10" 8 OZ. FLANGE E-VENT KIT	19	1	1" PICK UP W/ DROP TUBE 6" ABOVE FROM BOTTOM OF TANK
9	4	LIFTING LUG	20	1	VALVE FOOT SINGLE POPPET 1"
10	1	3" UPDRAFT STACK W/3" 354 SLIP ON	21	1	ROM DOOR 3'x3'
11	1	UL LISTED LOCKABLE 3'6"x4'2"x4' FILL BOX, CROSS BROKEN FOR EASY DRAINAGE, 2" STACK VENT AND 1/2" BALL VALVE	22	1	TANK DECAL KIT (NOT SHOWN)
			23	1	TOUCH UP PAINT (NOT SHOWN AND SHIPPED SEPARATELY)

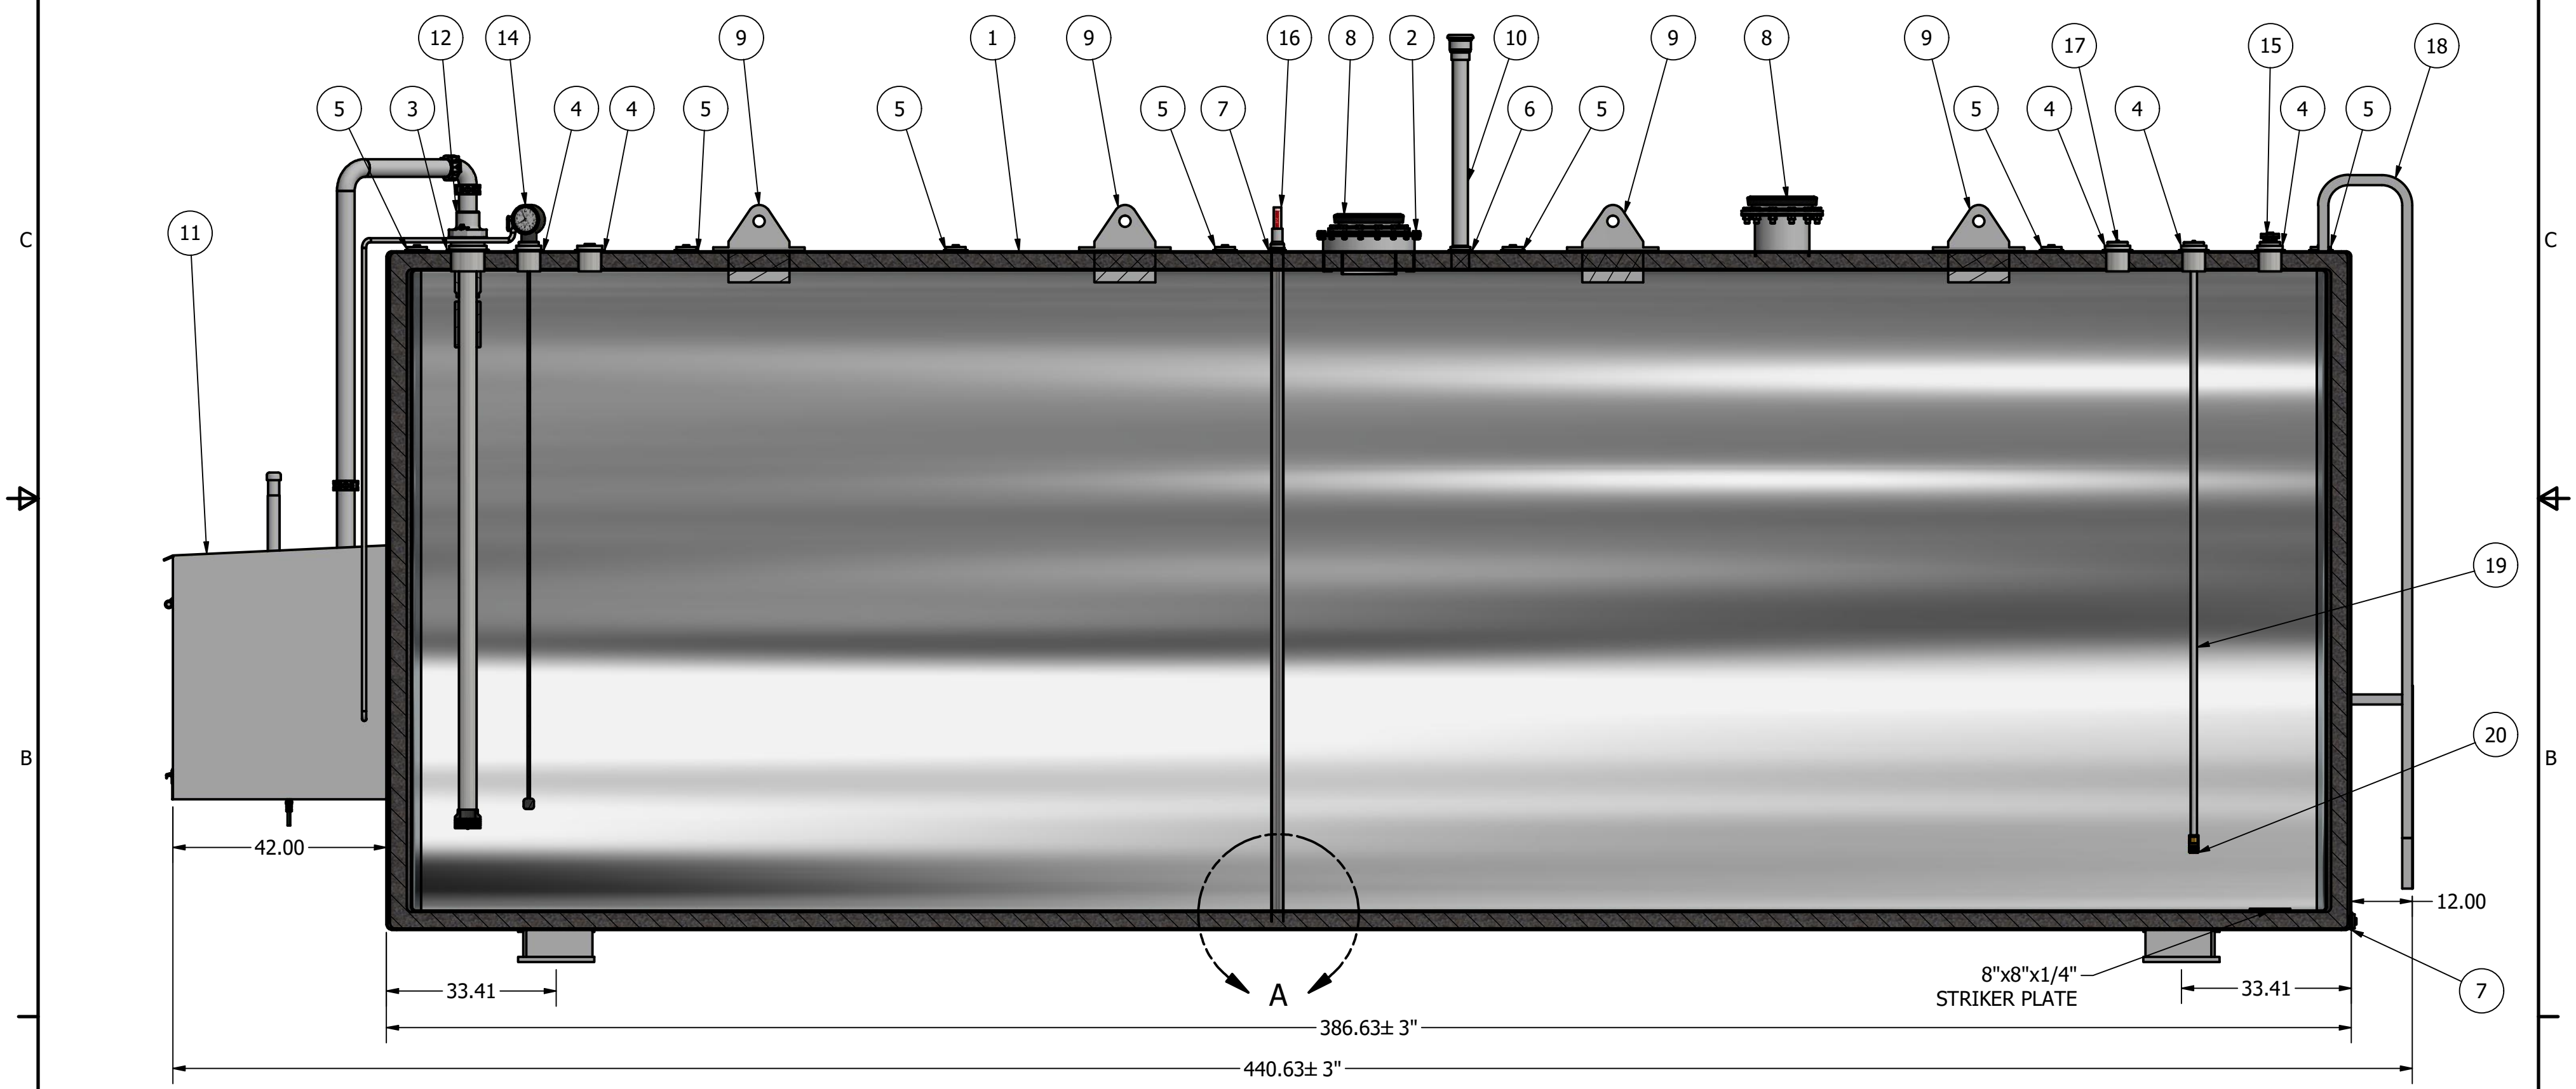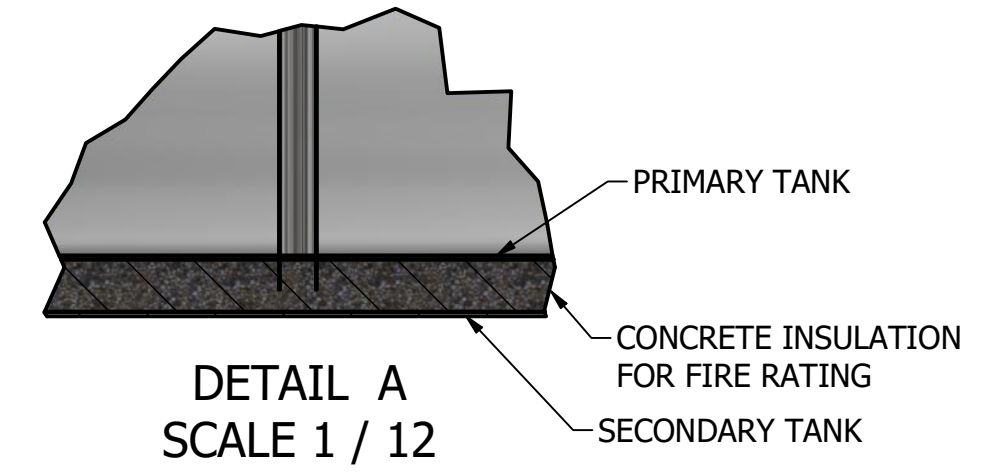

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN



SHELL THICKNESS: 5/16"
HEAD THICKNESS: 5/16"
STI
SwRI
UL


This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

DRAWN BY	AP	4/24/2020
MEMCO REP		
QUOTE #		
Customer Approval Signature		

MEMCO, INC

envirosafe™
20,000 GALLON FIREGUARD GENERATOR SYSTEM
ABOVE-GROUND FUEL SYSTEMS

SIZE	DWG NO	REV
C		
SCALE	SHEET 2 OF 5	

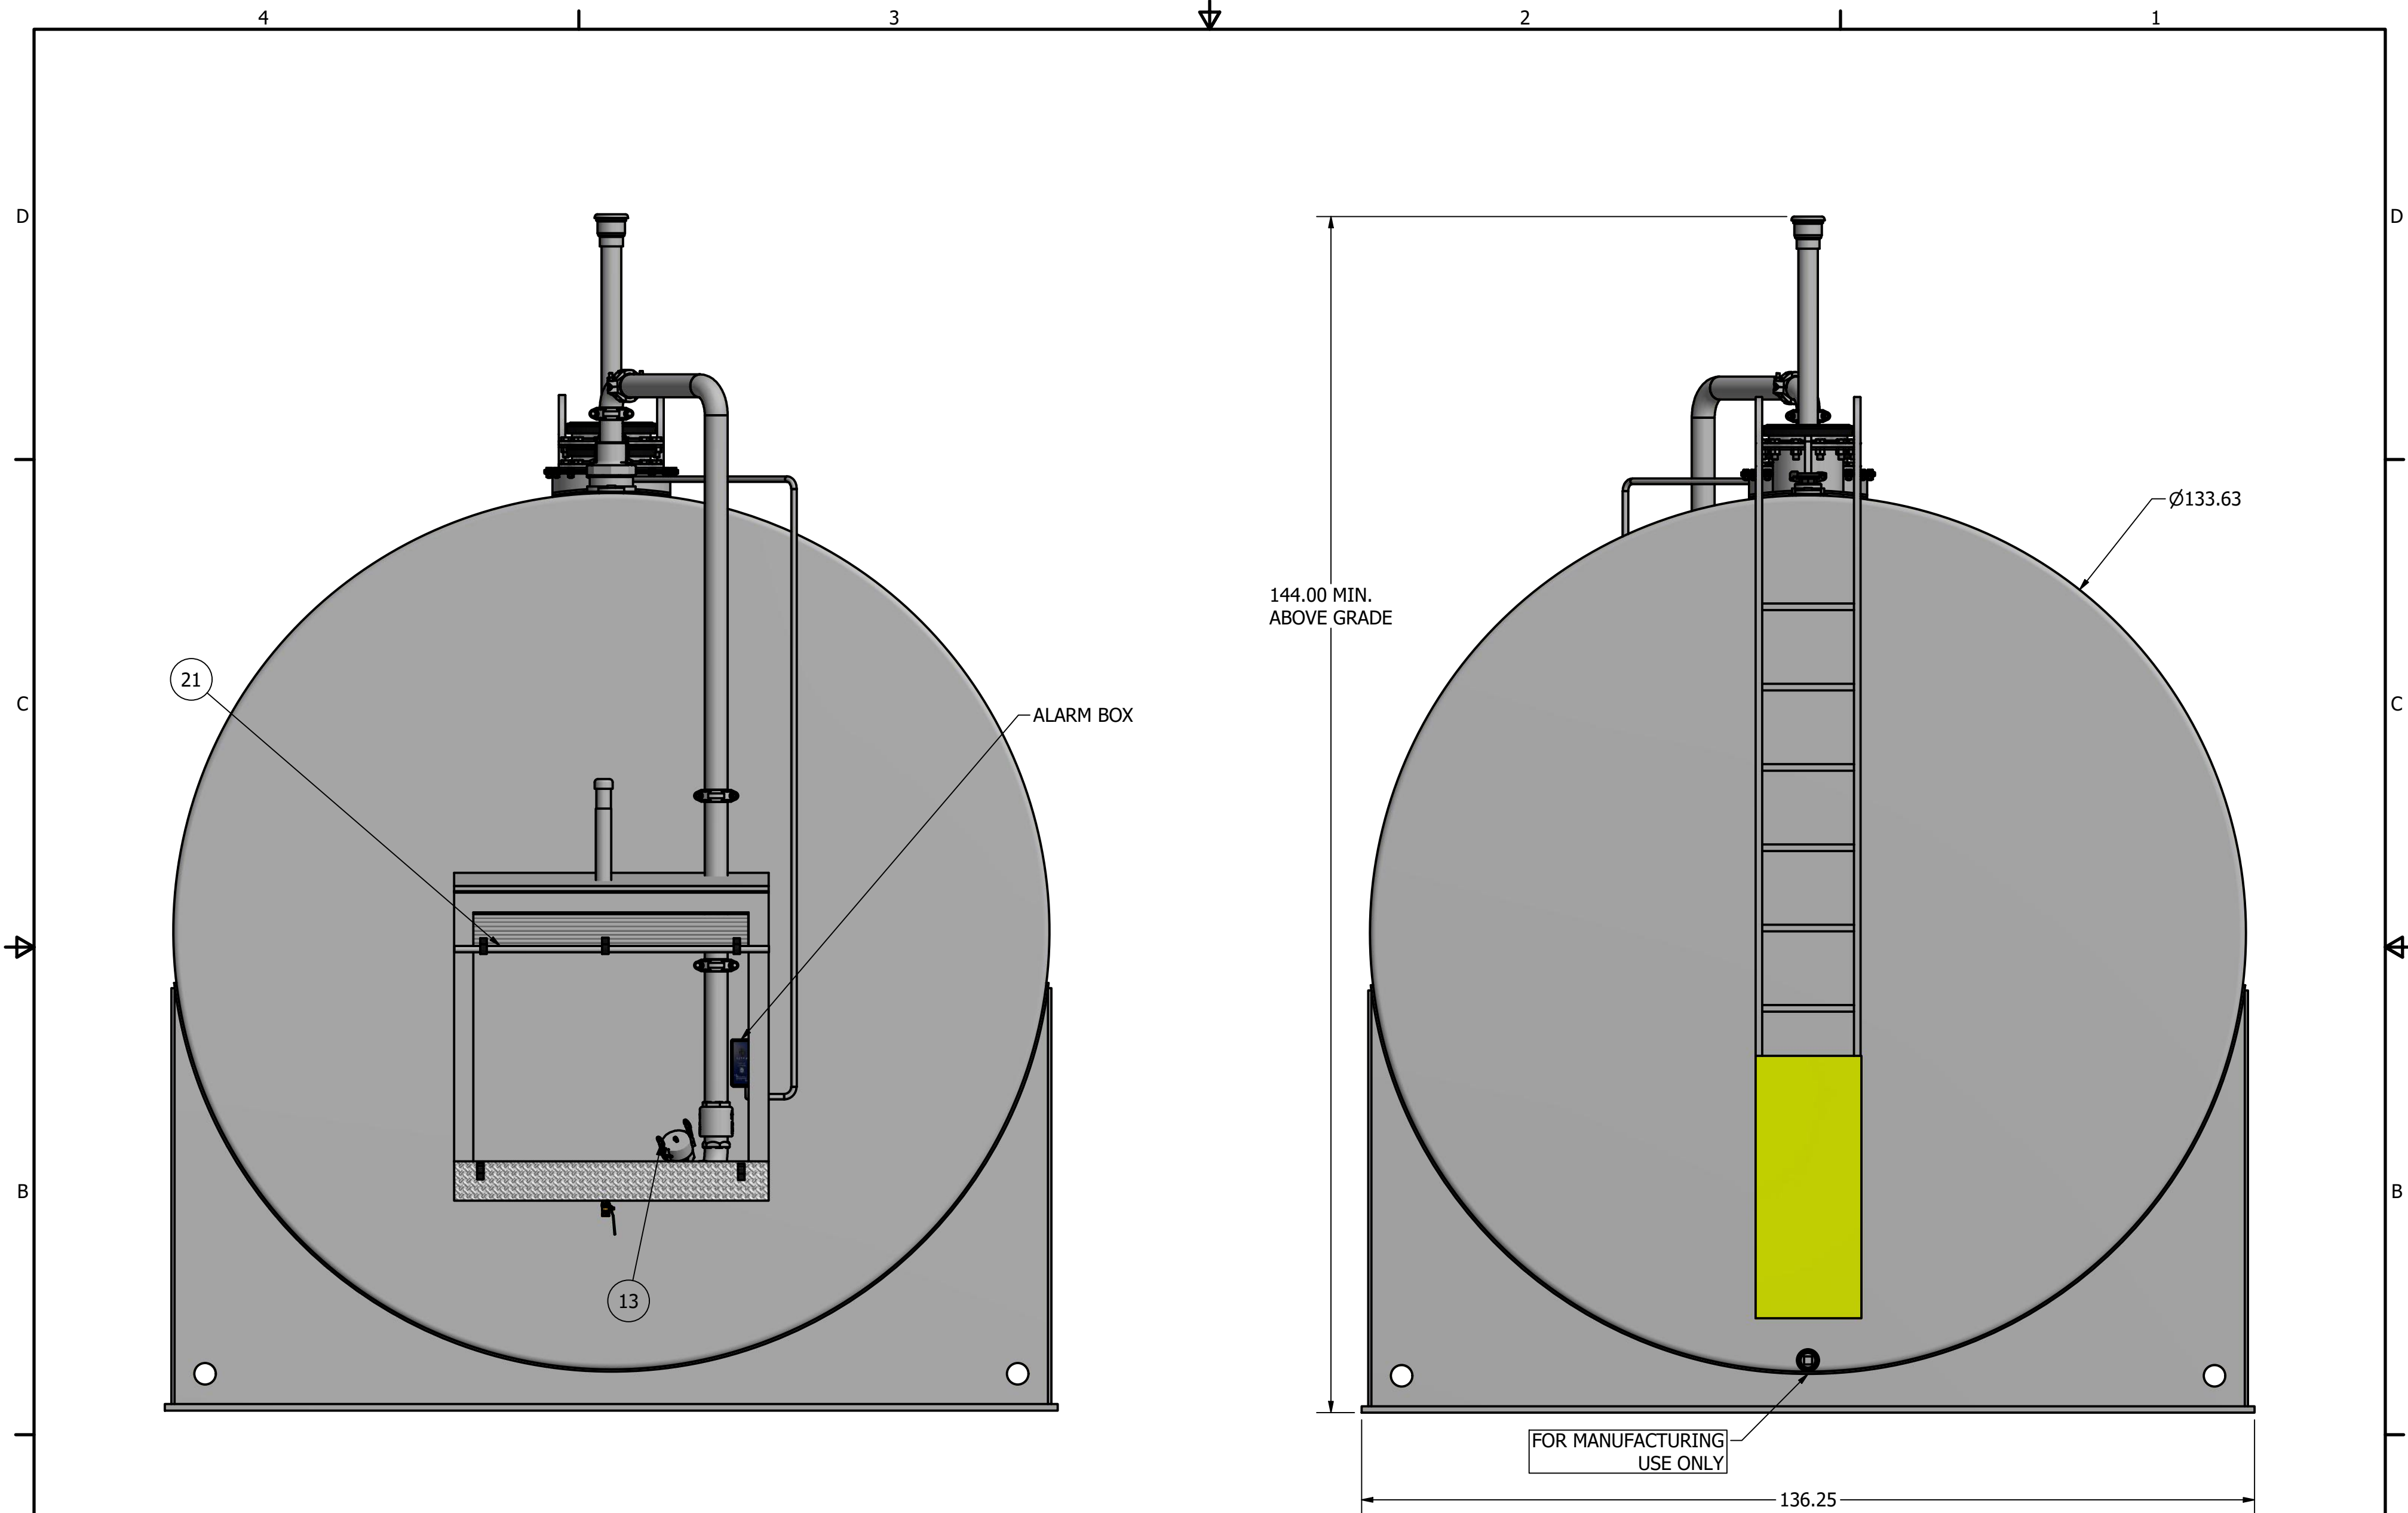


LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN


#

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

STI
SwRI
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP		4/24/2020		MEMCO, INC	
MEMCO REP					
QUOTE #				 20,000 GALLON FIREGUARD GENERATOR SYSTEM ABOVE-GROUND FUEL SYSTEMS	
Customer Approval Signature					
SIZE C	DWG NO			REV	
SCALE				SHEET 3 OF 5	

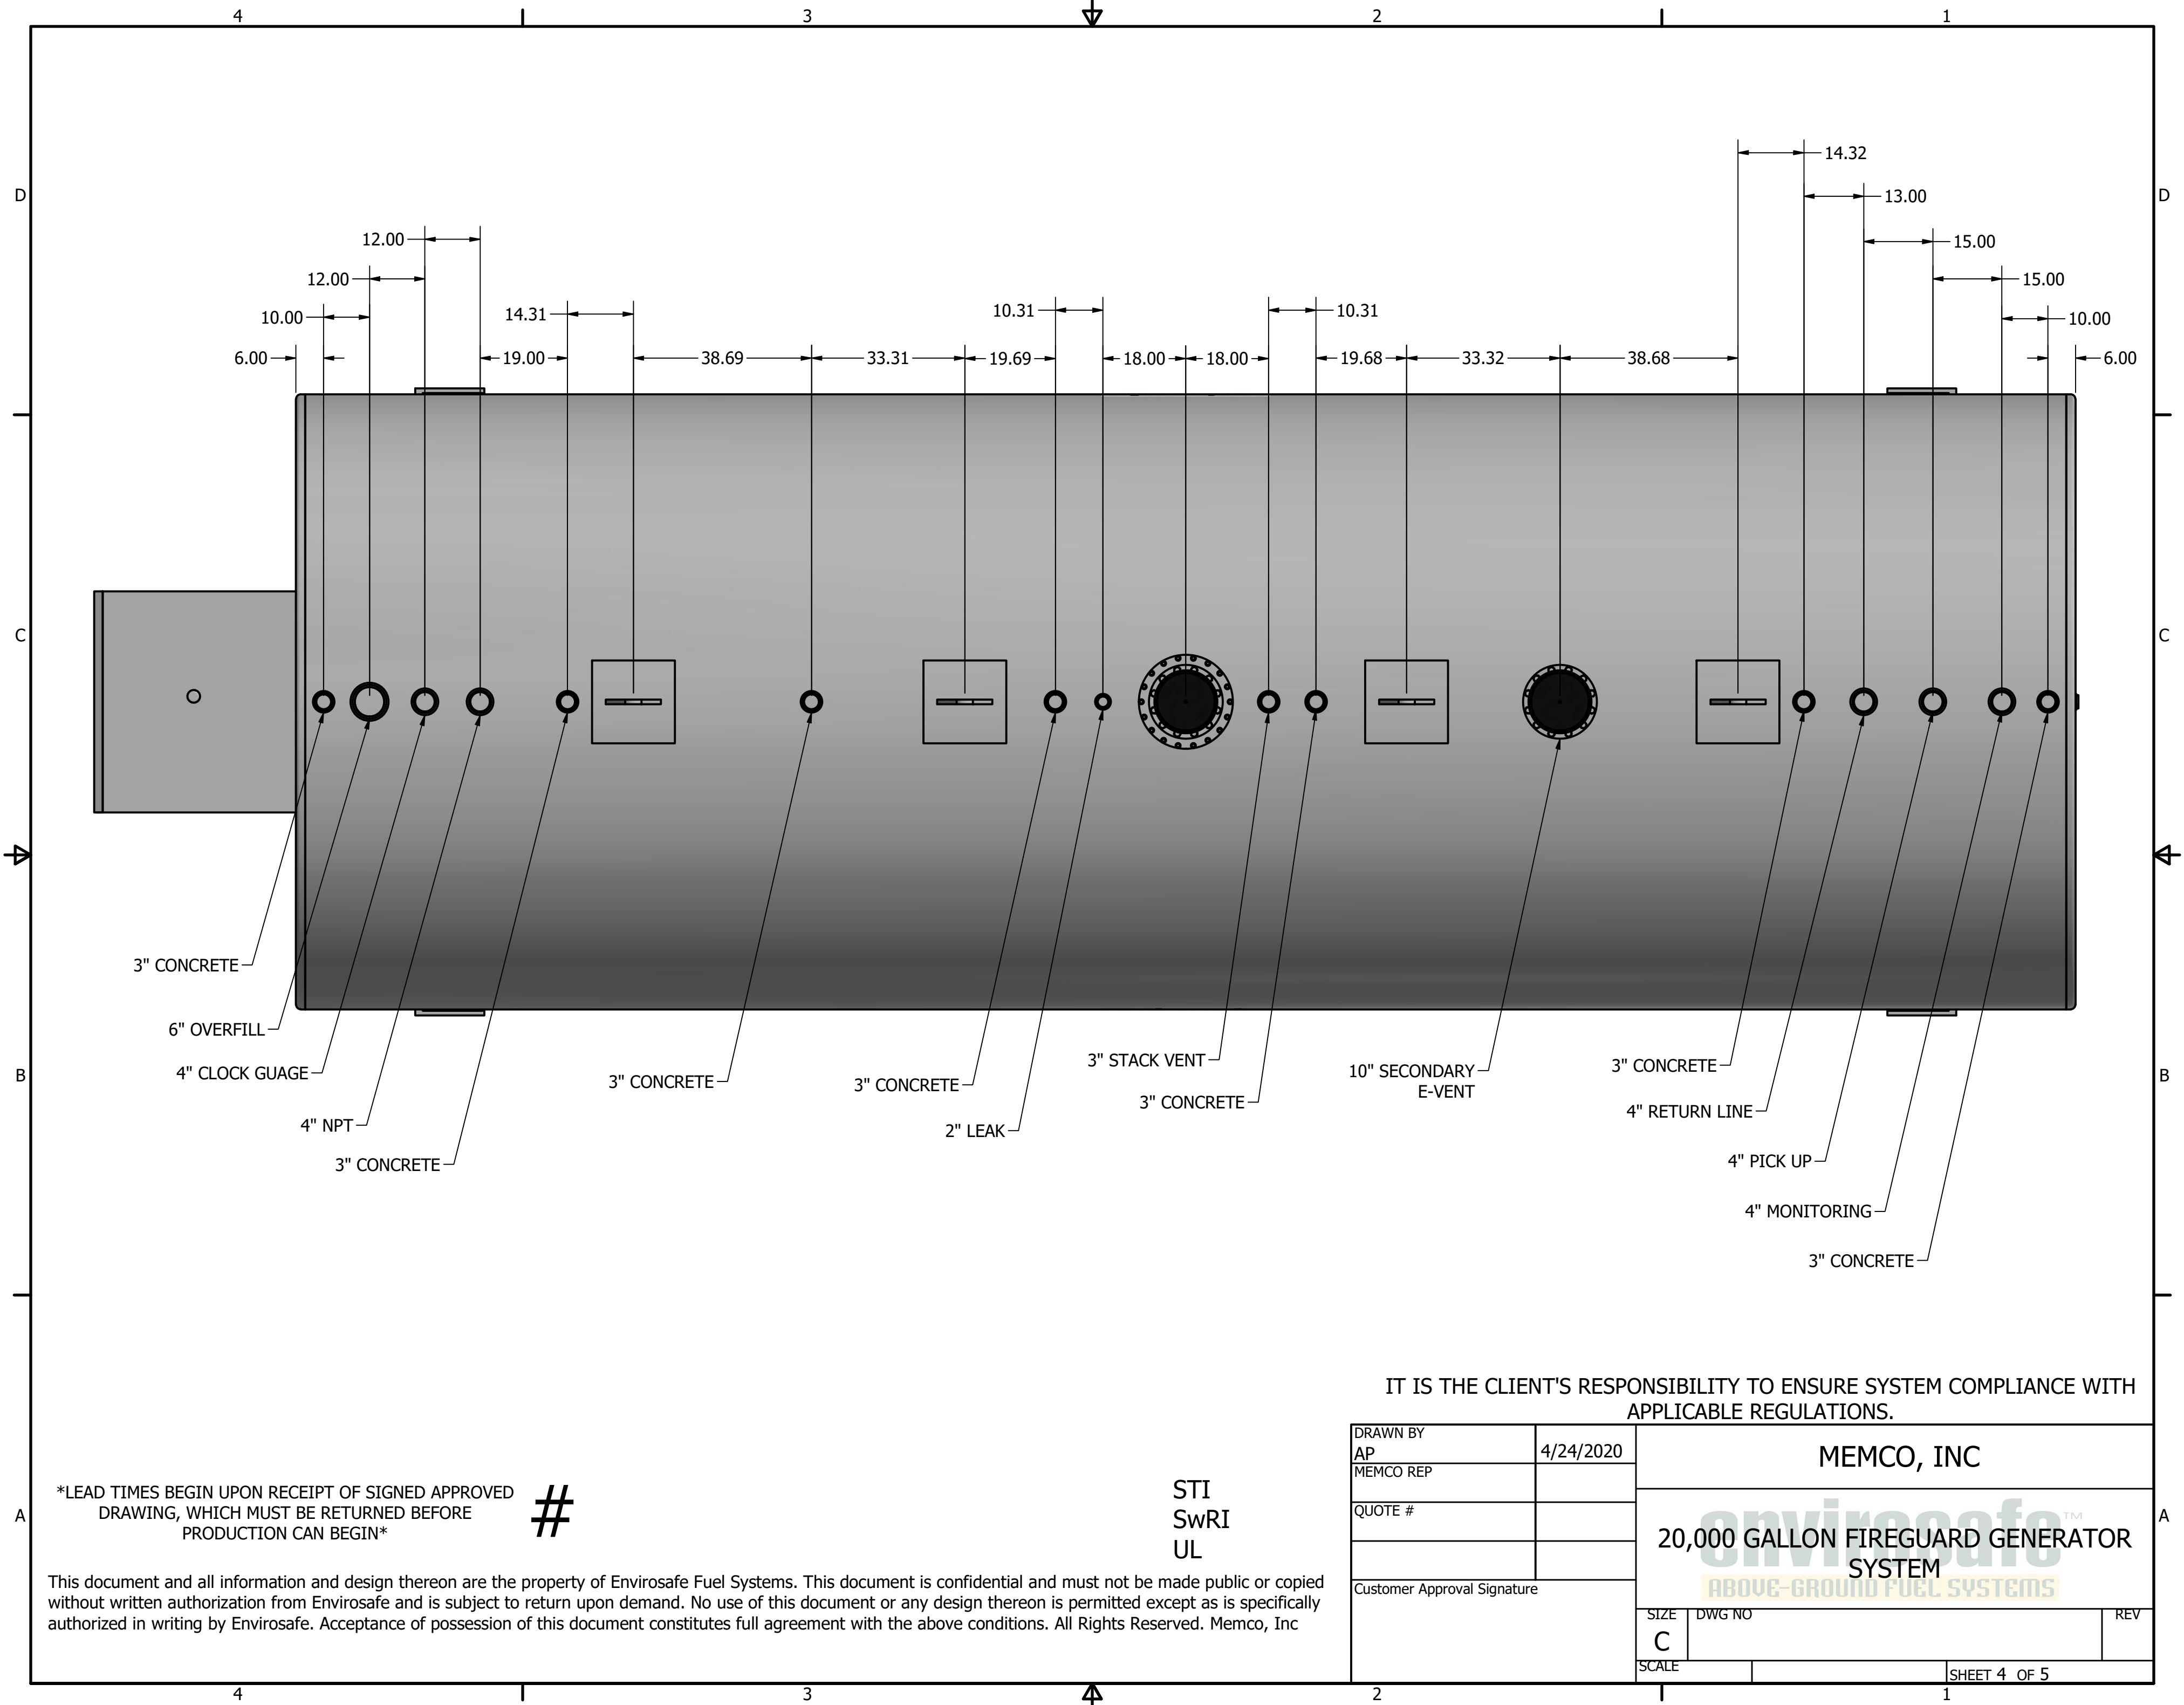

3" CONCRETE

6" OVERFILL

4" CLOCK GAUGE

4" NPT

3" CONCRETE

3" CONCRETE

3" CONCRETE

2" LEAK

3" STACK VENT

3" CONCRETE

10" SECONDARY E-VENT

3" CONCRETE

4" RETURN LINE

4" PICK UP

4" MONITORING

3" CONCRETE

LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN

#

STI
SwRI
UL

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY	AP	4/24/2020
MEMCO REP		
QUOTE #		
Customer Approval Signature		

MEMCO, INC

20,000 GALLON FIREGUARD GENERATOR SYSTEM


ABOVE-GROUND FUEL SYSTEMS

SIZE	DWG NO	REV
C		
SCALE	SHEET 4 OF 5	

This document and all information and design thereon are the property of EnviroSAFE Fuel Systems. This document is confidential and must not be made public or copied without written authorization from EnviroSAFE and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by EnviroSAFE. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc

PARTS LIST			
ITEM	QTY	DESCRIPTION	PART NUMBER
1	1	20,000 GALLON FIREGUARD TANK MOUNTED ON SADDLES	2000-Secondary-Tank
2	1	18" MANWAY W/10" NECK FOR EASY INNER TANK ACCESSIBILITY	P-18" MANWAY-10
3	1	6 IN NPT THREADED FLANGE	P-SERIES-159
4	5	4 IN NPT THREADED FLANGE	P-SERIES 262
5	7	3" NPT THREADED FLANGE (CONCRETE PORT)	P- SERIES 260
6	1	3 IN NPT THREADED FLANGE	P-SERIES 260
7	2	2 IN NPT THREADED FLANGE	P-SERIES 158
8	2	10" 8 OZ. FLANGE E-VENT KIT	P-244OF-10080 AK
9	4	LIFTING LUG	S-LIFTING LUG NEW SIZE
10	1	3" UPDRAFT STACK W/3" 354 SLIP ON	3" STACK, P-354-0300AV
11	1	UL LISTED LOCKABLE 3'6"x4'2"x4' FILL BOX, CROSS BROKEN FOR EASY DRAINAGE, 2" STACK VENT AND 1/2" BALL VALVE	M-SMALL BOX
12	1	3" OVERFILL PREVENTION VALVE WITH TEST MECHANISM AND DIFFUSER	P-9095AA-3300AVEVR, P-9095ATM-0100 AM
13	1	3" GROUND LEVEL FILL WITH DUST CAP AND ADAPTOR	M-J FILL
14	1	918 CLOCK GAUGE WITH ALARM BOX & STANDARD FLOAT	P-918-0100AG
15	1	MONITORING CAP 2"	P-179M-0100AC
16	1	INTERSTITIAL LEAK GAUGE	P-K-2-96
17	1	MEMCO 1" RETURN LINE FITTINGS ONLY	P-184-2200 MB
18	1	STEP LADDER WITH SAFETY SHIELD	10 FT LADDER
19	1	1" PICK UP W/ DROP TUBE 6" ABOVE FROM BOTTOM OF TANK	M-1IN PICK UP W/DROP TUBE
20	1	VALVE FOOT SINGLE POPPET 1"	P-334-0200AV
21	1	ROM DOOR 3'x3'	P-ROM DOOR SMALL
22	1	TANK DECAL KIT (NOT SHOWN)	P-TANK DECAL KIT
23	1	TOUCH UP PAINT (NOT SHOWN AND SHIPPED SEPARATELY)	

IT IS THE CLIENT'S RESPONSIBILITY TO ENSURE SYSTEM COMPLIANCE WITH APPLICABLE REGULATIONS.

DRAWN BY AP	4/24/2020	MEMCO, INC	
MEMCO REP			
QUOTE #		 20,000 GALLON FIREGUARD GENERATOR SYSTEM <small>ABOVE-GROUND FUEL SYSTEMS</small>	
Customer Approval Signature			
SIZE C	DWG NO	REV	
SCALE	SHEET 5 OF 5		

LEAD TIMES BEGIN UPON RECEIPT OF SIGNED APPROVED DRAWING, WHICH MUST BE RETURNED BEFORE PRODUCTION CAN BEGIN

#

STI
SwRI
UL

This document and all information and design thereon are the property of Envirosafe Fuel Systems. This document is confidential and must not be made public or copied without written authorization from Envirosafe and is subject to return upon demand. No use of this document or any design thereon is permitted except as is specifically authorized in writing by Envirosafe. Acceptance of possession of this document constitutes full agreement with the above conditions. All Rights Reserved. Memco, Inc